NOTES:

1. MINIMUM AISLE CLEARANCE 36" FROM BOILER SIDES AND REAR. (THIS REQUIREMENT MAY VARY WITH LOCATION. CHECK STATE AND LOCAL CODES IN THE AREA OF INSTALLATION.)
2. OPTIONS AND ADDITIONAL EQUIPMENT ORDERED MAY AFFECT OVERALL DIMENSIONS. DRAWINGS ARE FOR STANDARD BOILER PACKAGE.
3. (16) 5/8 UNC X 1.500 LONG STUDS EQUALLY SPACED STRADDLE CENTERLINES. STUDS FOR BURNER REFRACTORY (DRY OVEN) MOUNTING. REFRACTORY MUST EXTEND 20.00" MINIMUM PAST MOUNTING FLANGE.

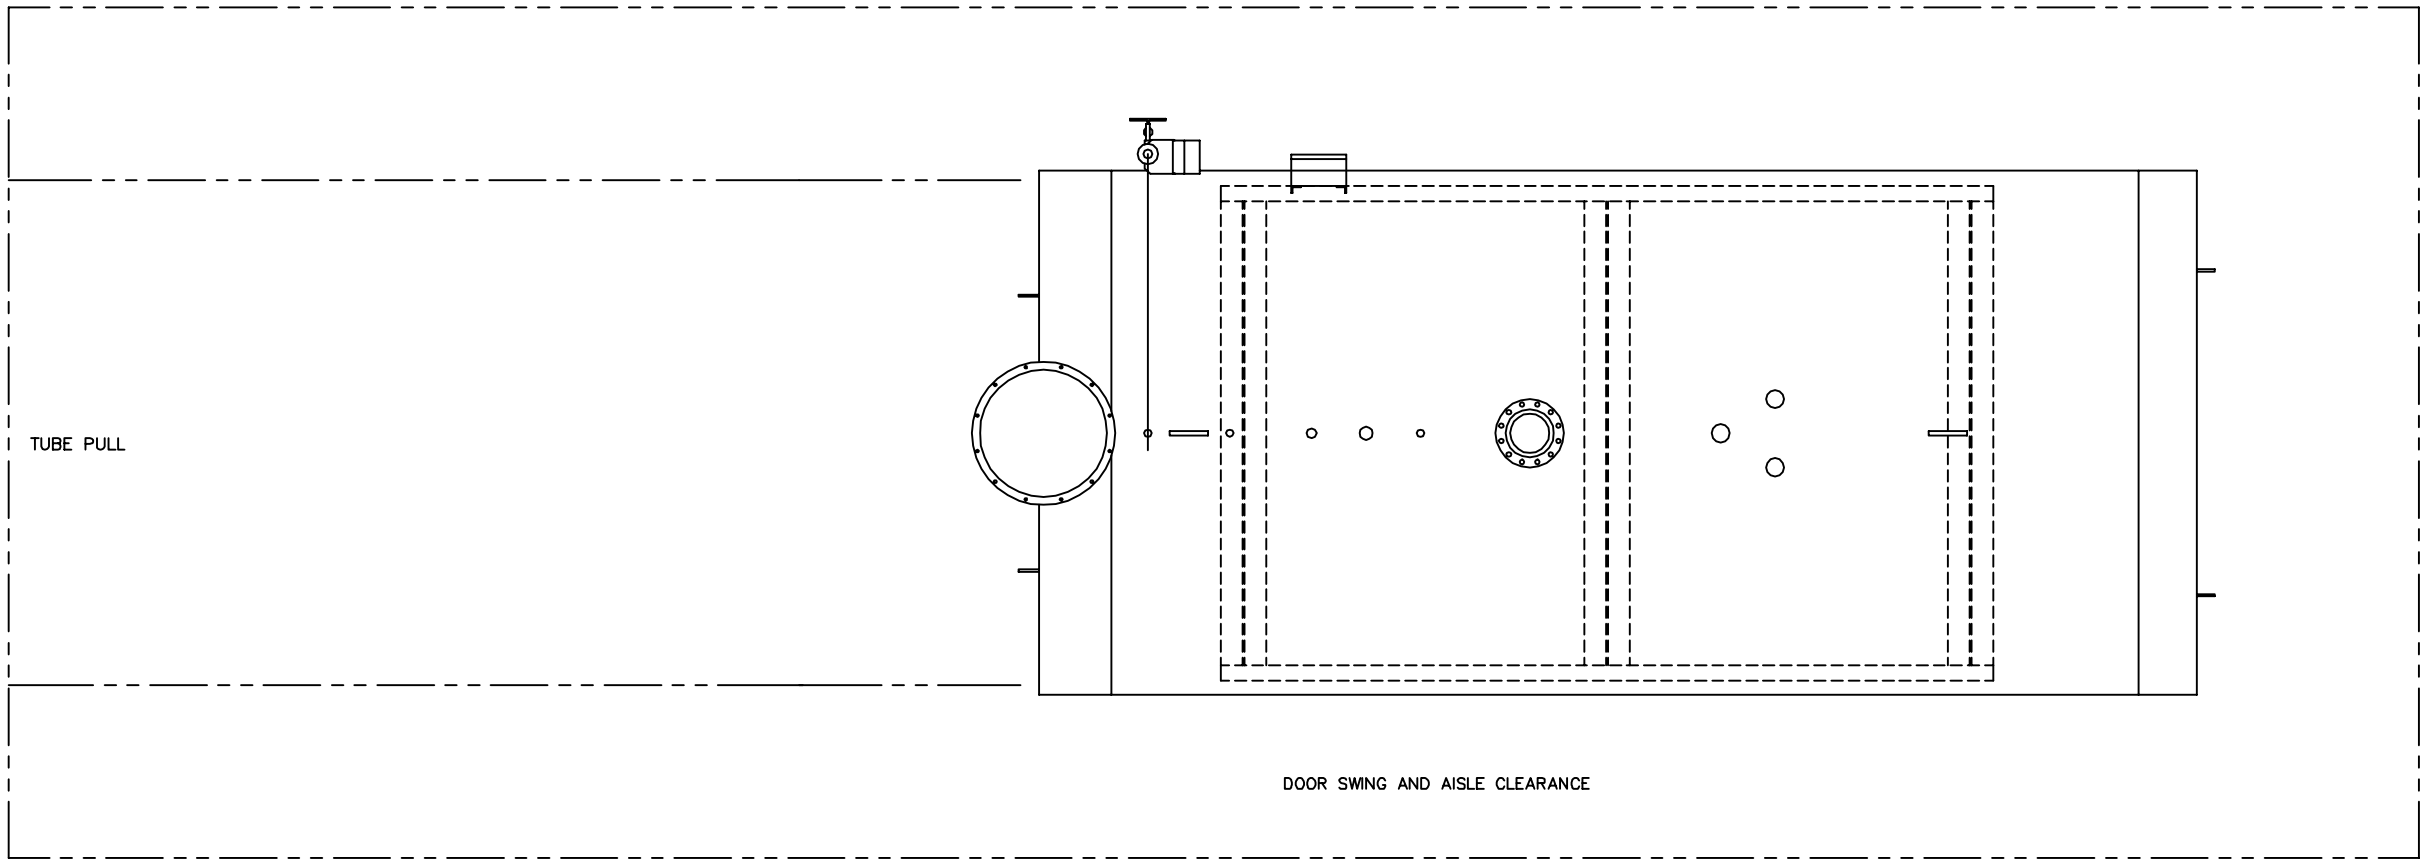

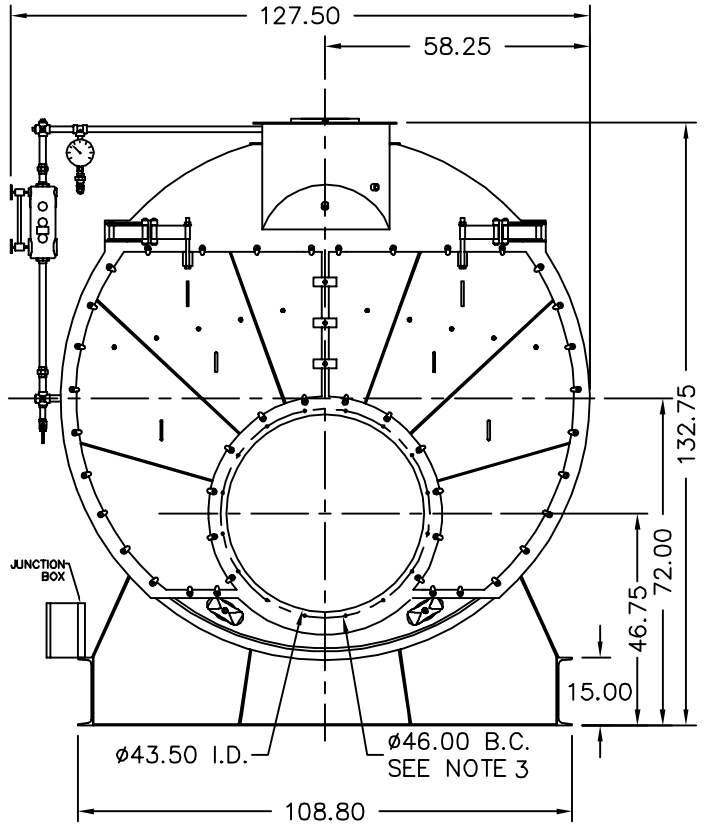

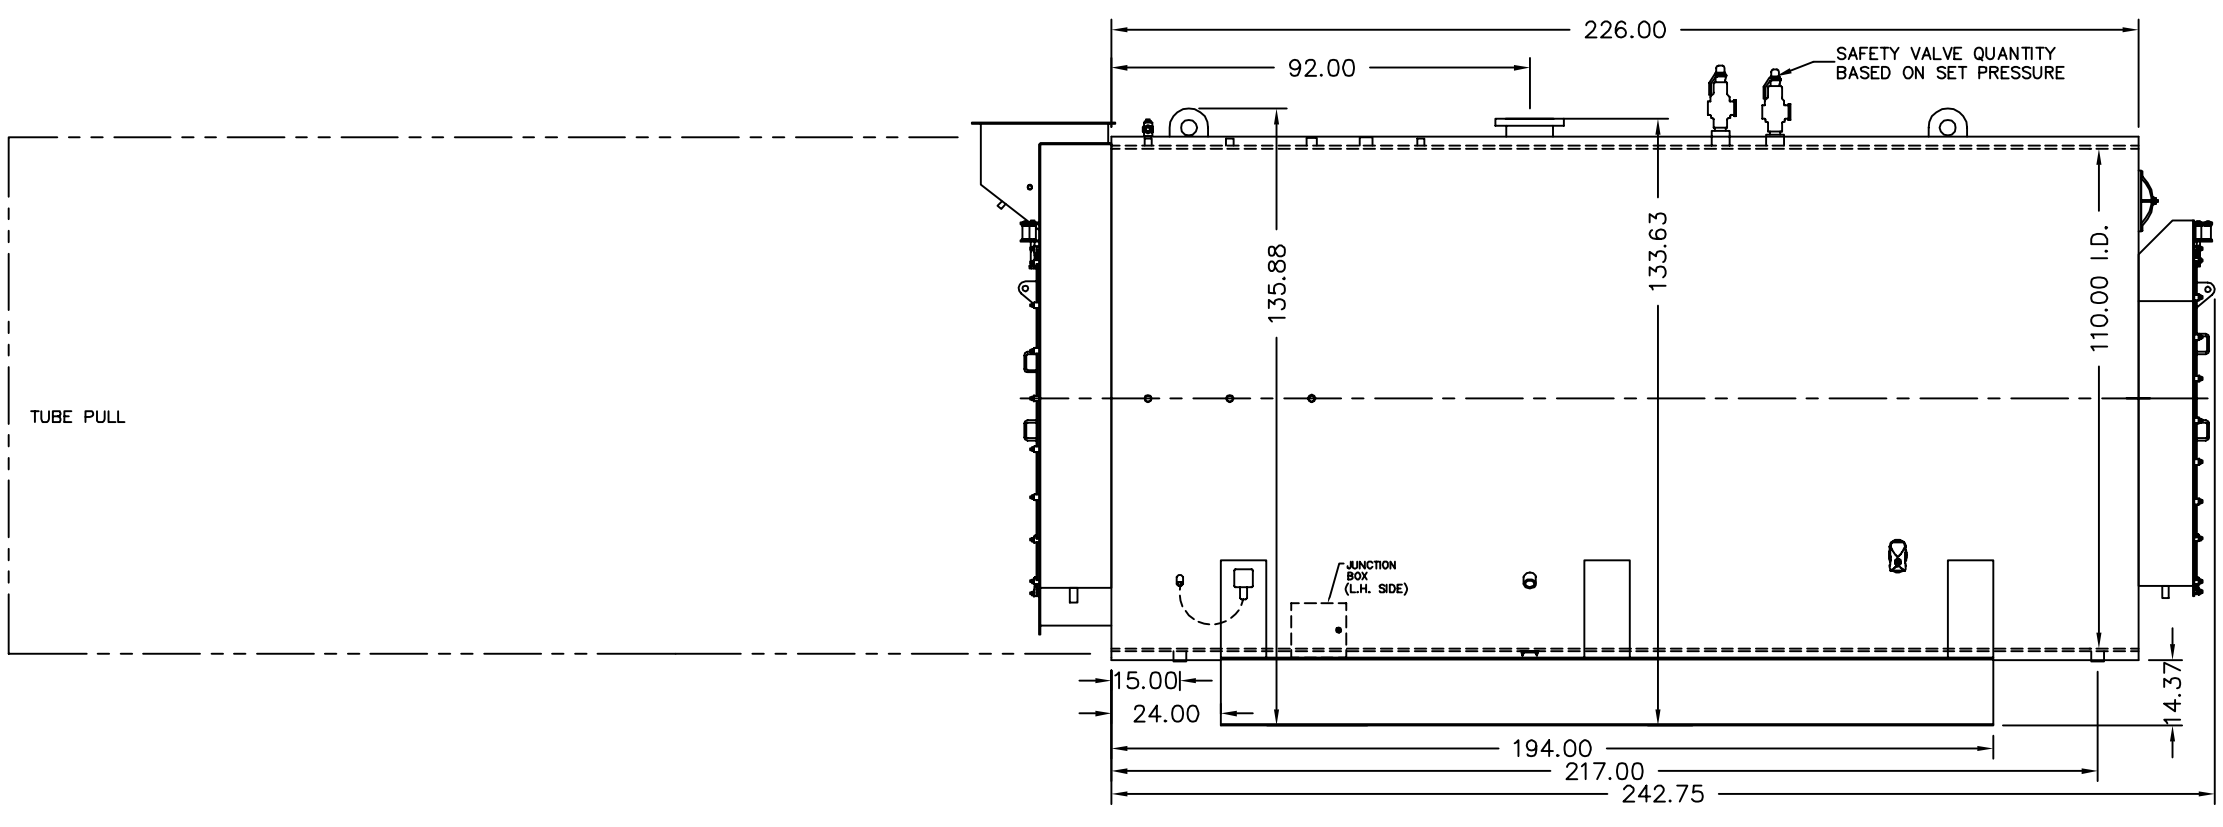

REFERENCE DRAWINGS

PLENUM:	#212B0156
PV:	#101B0742
P.V. BASE:	#201B0292
FR FLUE BOX:	#205B0149
RR FLUE BOX:	#206B0139

THIS DRAWING IS THE PROPERTY OF THE JOHNSTON BOILER COMPANY. THE DISCLOSURES CONTAINED ON THIS DRAWING ARE MADE WITH THE UNDERSTANDING THAT THEY ARE CONFIDENTIAL AND WILL NOT BE USED IN ANY WAY DETRIMENTAL TO THIS COMPANY'S INTEREST.

JOHNSTON BOILER COMPANY

SCALE CAD/FULL	
DATE 2-6-07	
DRAWN JRS	
CHECKED	
APPROVED	

JOHNSTON BOILER COMPANY
FERRYSBURG, MICHIGAN 49409

SO#

BOILER TEMPLATE – 509
PFTX800-4-150#S

DWG. NO. 300B0371-03 REV

DWG NO. 300B0371
REVISIONS